

SECTION A-A


NOTE:
ALL CONCRETE SHALL TEST
4200 P.S.I. @ 28 DAYS

CURING COMPOUND SHALL BE APPLIED
TO ALL EXPOSED SURFACES


4" OF ITEM 304 OR 411 GRAVEL SHALL BE
PLACED UNDER SIDEWALK

NOTE:
ALL TREADS ARE TO BE
1'-0" WIDE UNLESS OTHER-
WISE SHOWN ON THE PLANS.
ALL RISERS SHALL BE OF
EQUAL HEIGHT AS DETER-
MINED BY FIELD CONDITIONS.
MAXIMUM RISER HEIGHT IS 8".



CONCRETE SIDEWALK
CONSTRUCTION DETAIL

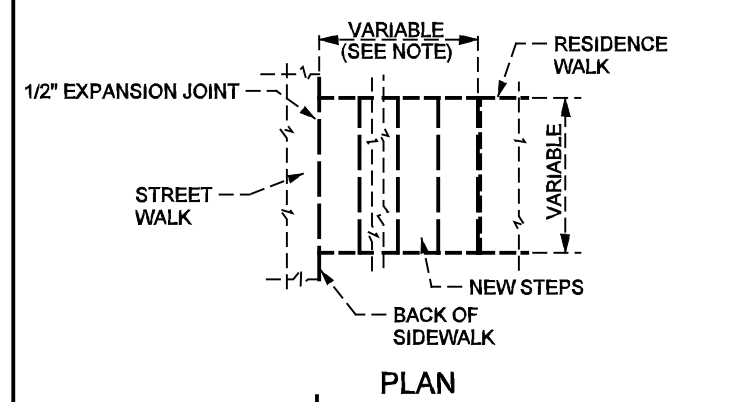


PLAN

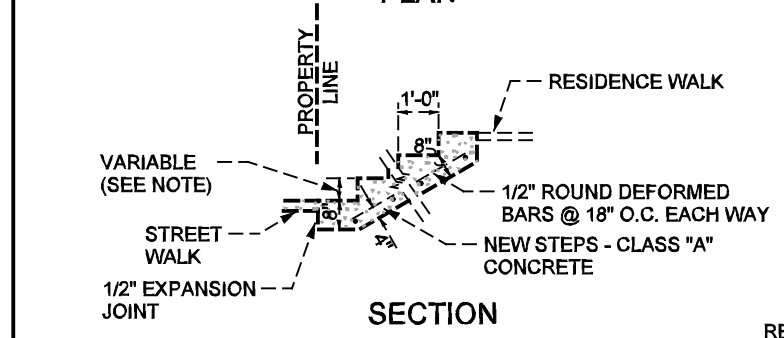


SECTION

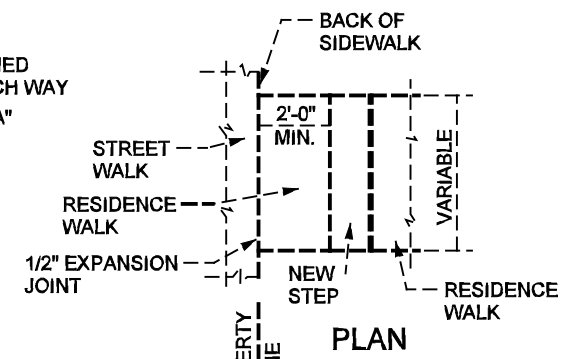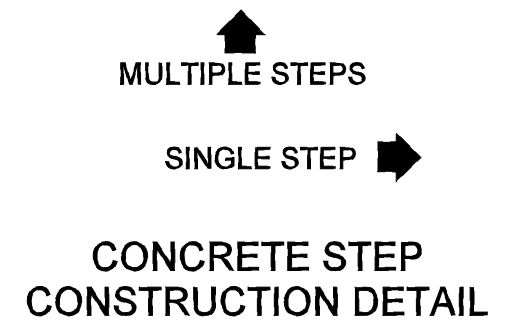

PLAN

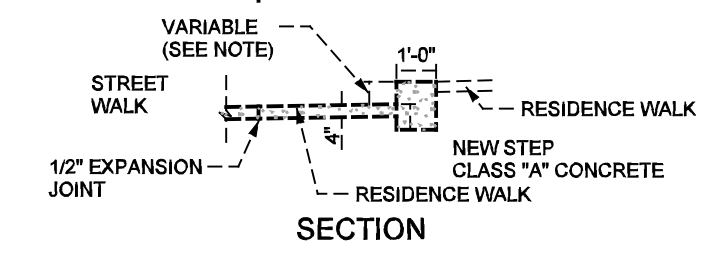

SECTION

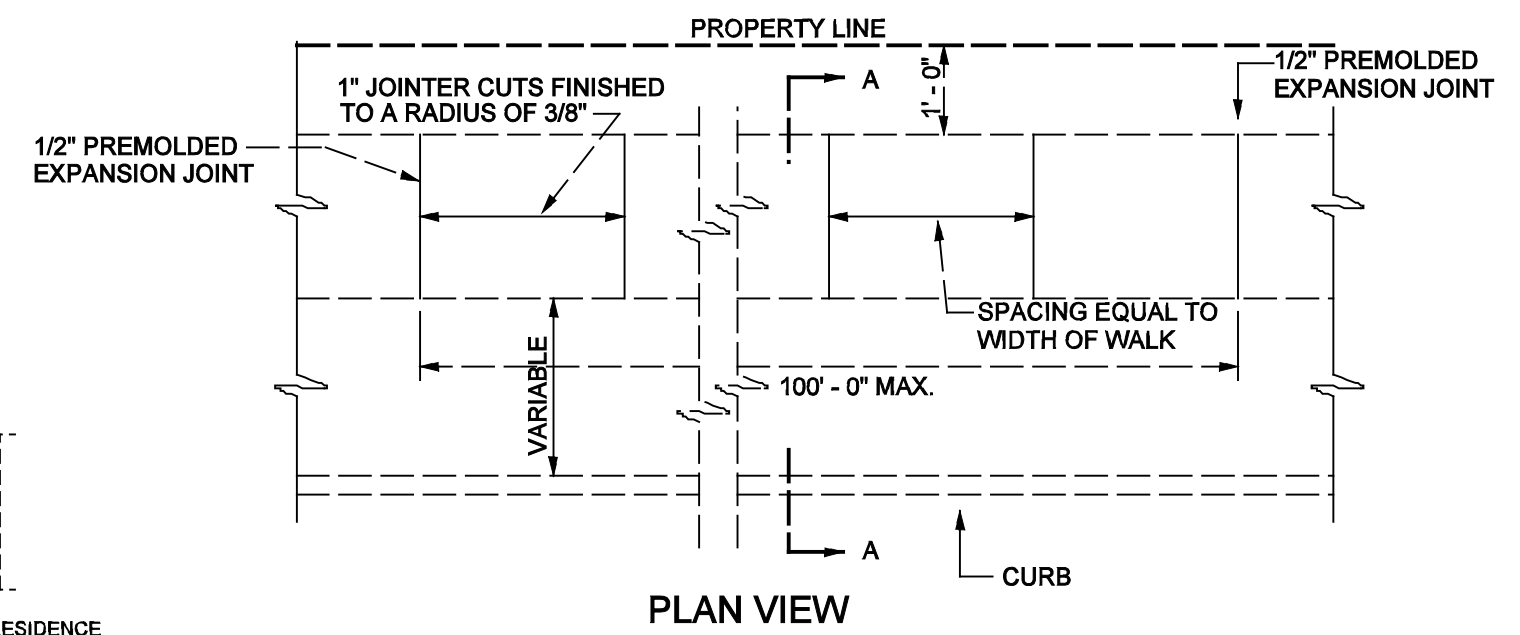

PLAN VIEW

- NOTES
1. PROVIDE BROOM FINISH TO ALL EXPOSED SURFACES.
 2. CONCRETE SHALL CONFORM TO ITEM 500, CAST IN PLACE CONCRETE.
 3. PROVIDE A MINIMUM OF 2" EDGING AROUND ALL EXPOSED SURFACES.